



NOTES:

1. SDR-35 PVC PIPE SHALL BE BEDDED WITH #57 STONE 6" MIN. THICKNESS ALL AROUND PIPE.
2. REFER TO RULES AND REGULATIONS FOR CLEANOUT REQUIREMENTS.
3. PLUMBING SHALL CONFORM TO ALL APPLICABLE CONSTRUCTION CODES.
4. BACKFLOW PREVENTER VALVES, IF USED, SHALL BE CONSTRUCTED WITH A WATERTIGHT RISER AND CLEANOUT LID.
5. ANY AREA DRAINS, FRENCH DRAINS, DOWNSPOUTS, SUMP PUMPS, OR OTHER SURFACE WATER OR GROUNDWATER SOURCE CONNECTIONS TO THE BUILDING SEWER OR LATERAL ARE PROHIBITED.
6. IF VENT LOCATION IS OFFSET DUE TO LATERAL RISER IN DRIVEWAY INSTALL CLEANOUT CAP PER DETAIL IN DRIVEWAY. TOP OF CAP SHALL BE FLUSH WITH TOP OF PAVEMENT OR GRAVEL SURFACE.
7. ALL RISER PIPE AND FITTINGS SHALL BE GLUED JOINTS.

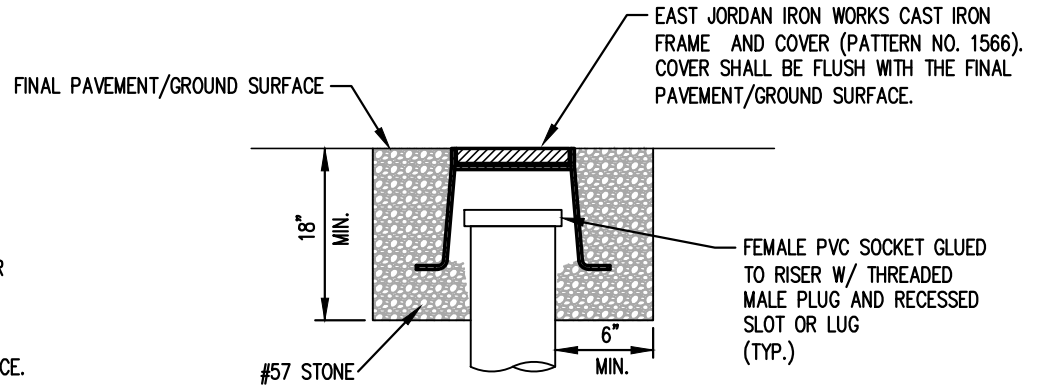

CLEANOUT CAP DETAIL

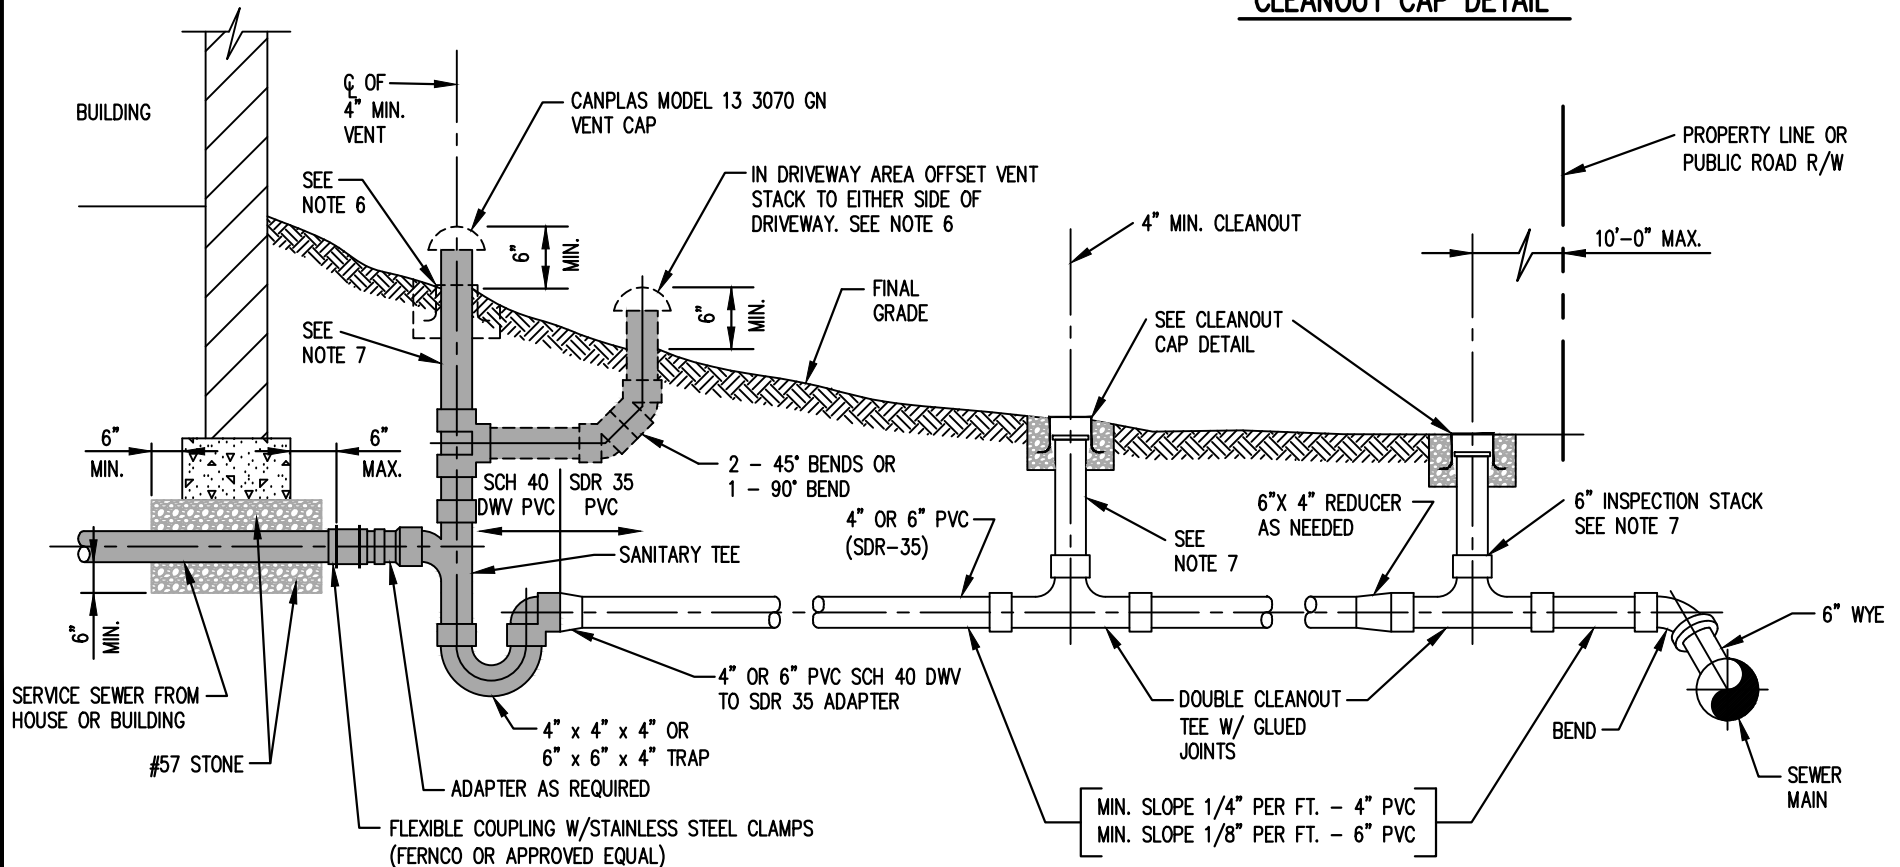

BUILDING SEWER AND LATERAL SEWER DETAIL